



Line Voltage, Single Three Button Station, and Reversing Edge Wiring.

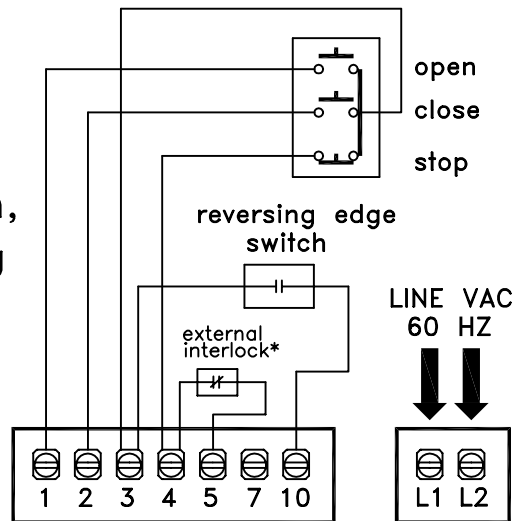

Operator Terminal Strips (Inside Control Box)
*When used remove brown wire internal jumper.

Single contact radio control installation

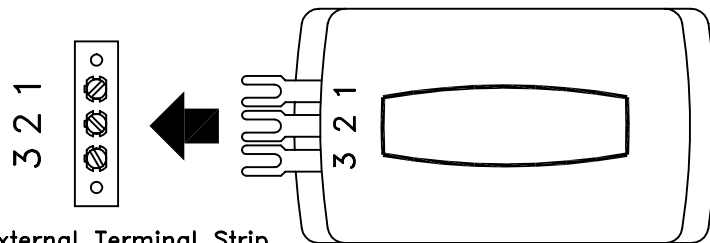


External Terminal Strip
(Side of Control Box)

NOTE: 3 BUTTON STATION MUST BE INSTALLED IN
ORDER FOR SINGLE CONTACT RADIO TO OPERATE.

Multiple 3 button station wiring

Station #1

Station #2 (See Note below)

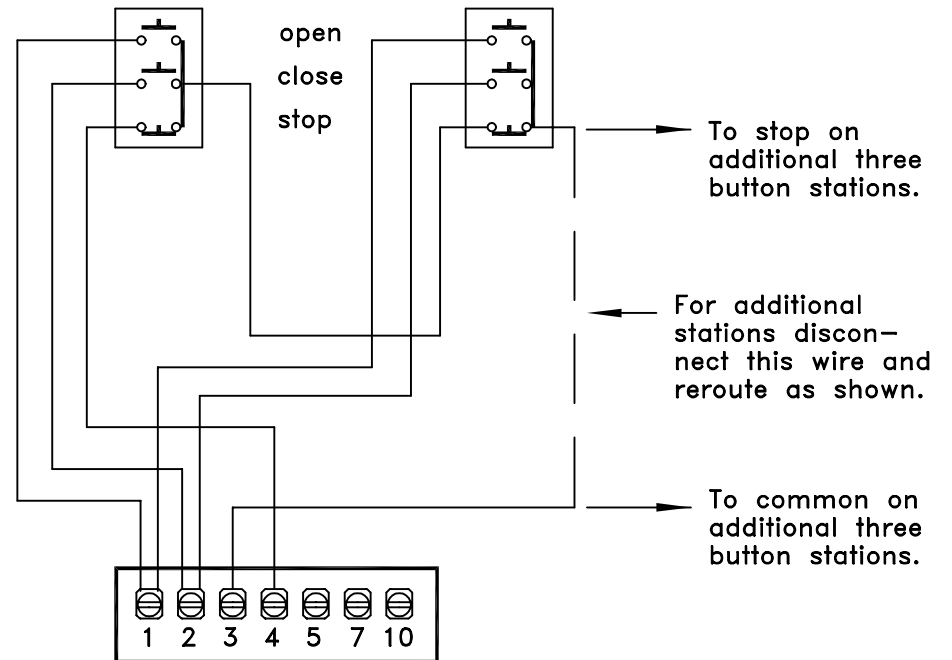

Operator Terminal Strip (Inside Control Box)

To stop on
additional three
button stations.

For additional
stations discon-
nect this wire and
reroute as shown.

To common on
additional three
button stations.